



NOTES


1. The culvert ends shall be mitered to match the embankment or ditch slope and shall not be mitered flatter than 4H : 1V. When slopes are between 4H : 1 V and 6H : 1 V, shape the slope in the vicinity of the culvert end to ensure that no part of the culvert protrudes more than 4" (in) above the ground line.
2. Field cutting of culvert ends is permitted when approved by the Engineer. All field-cut culvert pipe shall be treated with treatment as shown in the Standard Specifications or General Special Provisions.

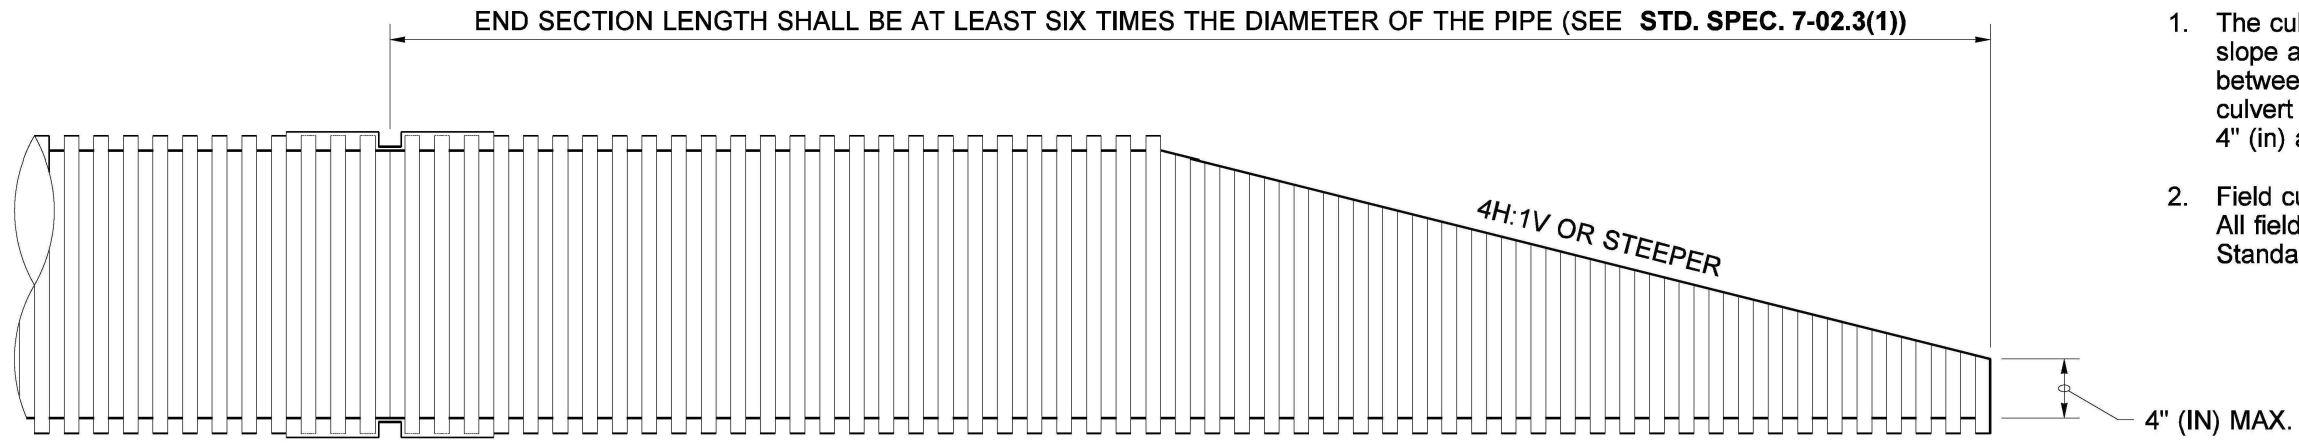

THERMOPLASTIC PIPE

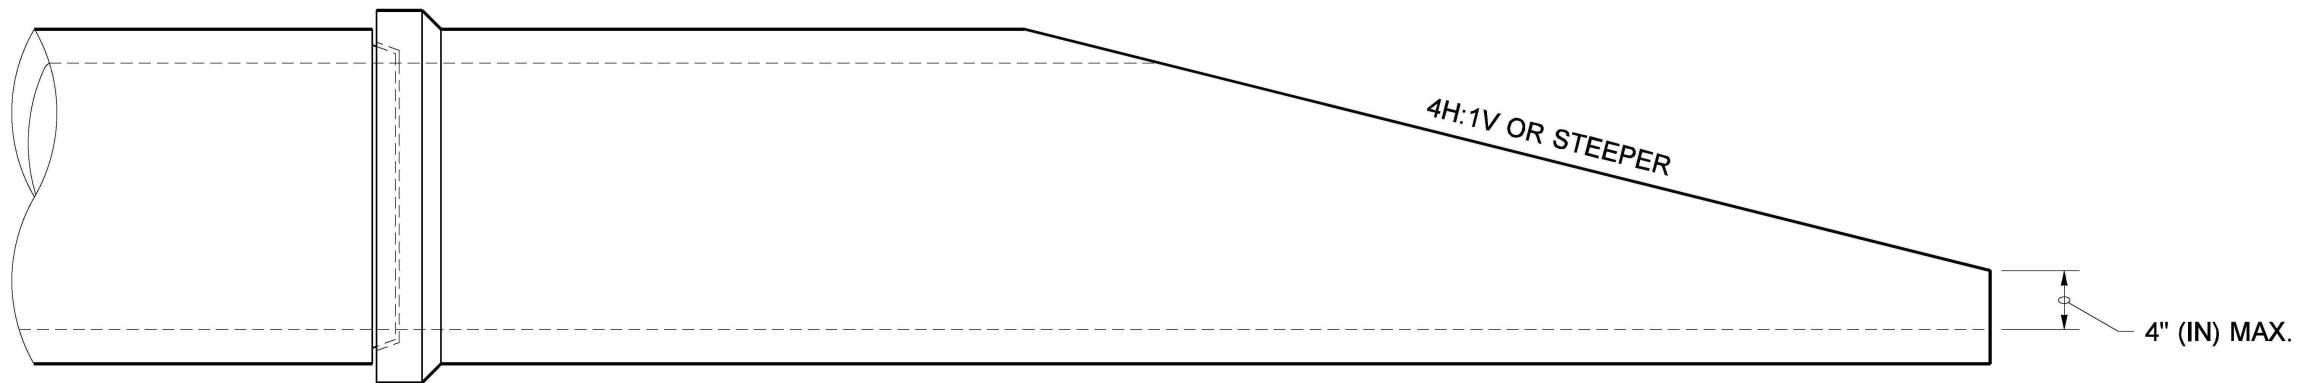

CONCRETE PIPE

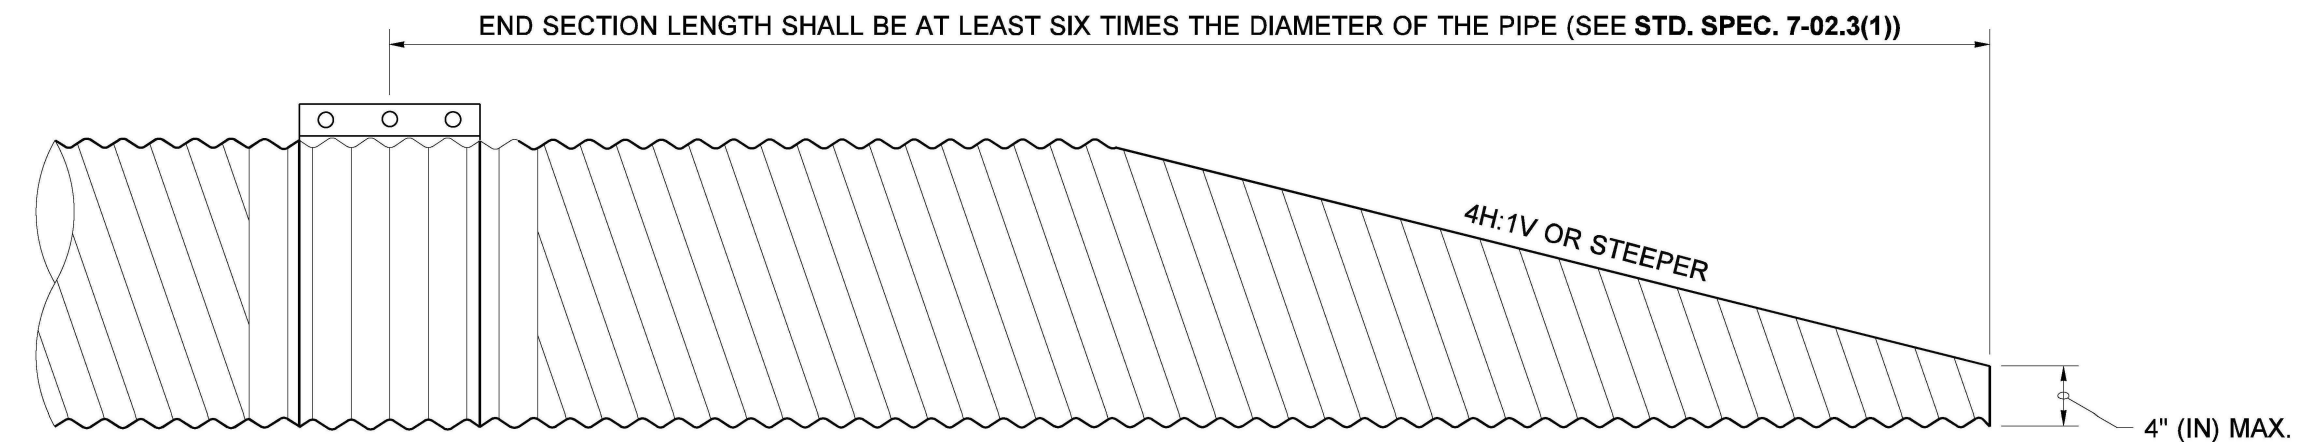

METAL PIPE

**FOR CULVERTS 30" (IN)
DIAMETER OR LESS**



Mar 14, 2022

MITERED END SECTIONS

STANDARD PLAN B-70.20-01

SHEET 1 OF 1 SHEET

APPROVED FOR PUBLICATION	Mar 15, 2022
<i>Mark Gaines</i>	
<small>Mark Gaines (Mar 15, 2022 22:26 PDT)</small>	
STATE DESIGN ENGINEER	
Washington State Department of Transportation	