

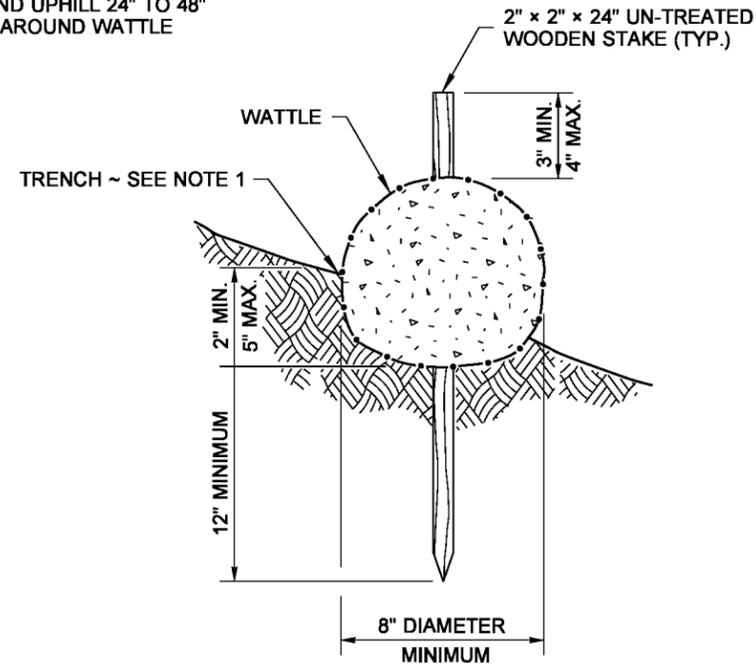


DRAWN BY: FERN LIDDELL

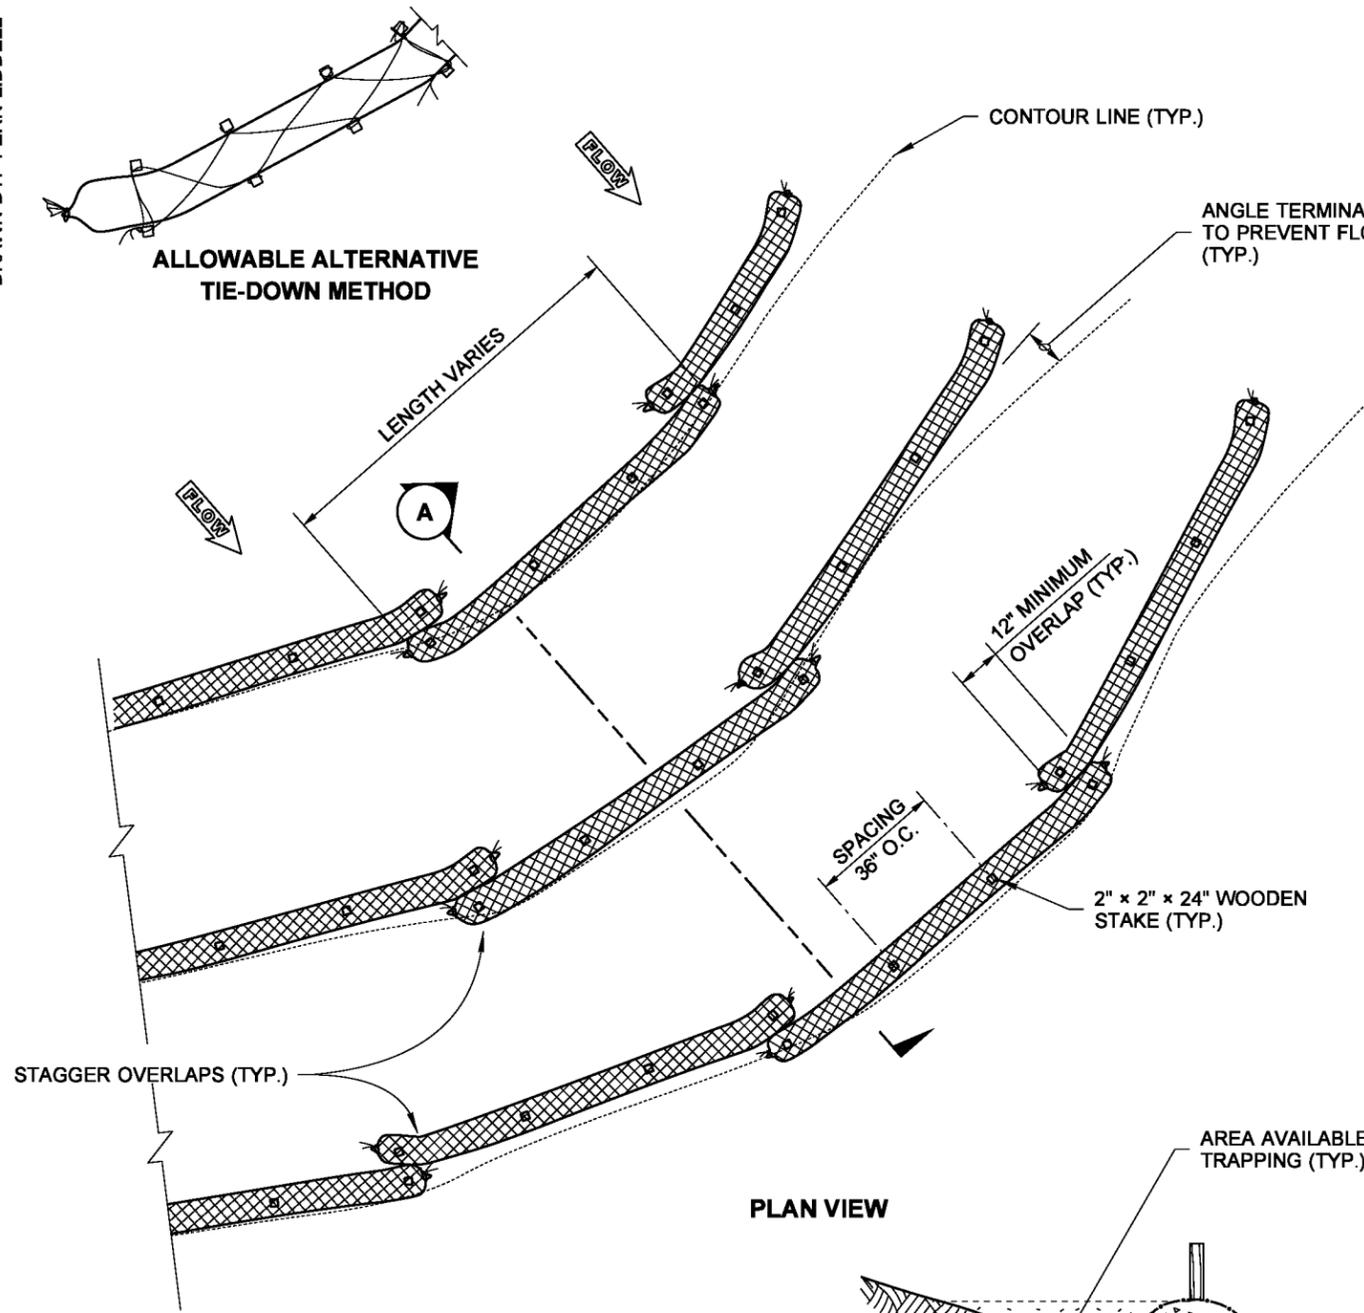

WATTLE DETAIL

PLAN VIEW

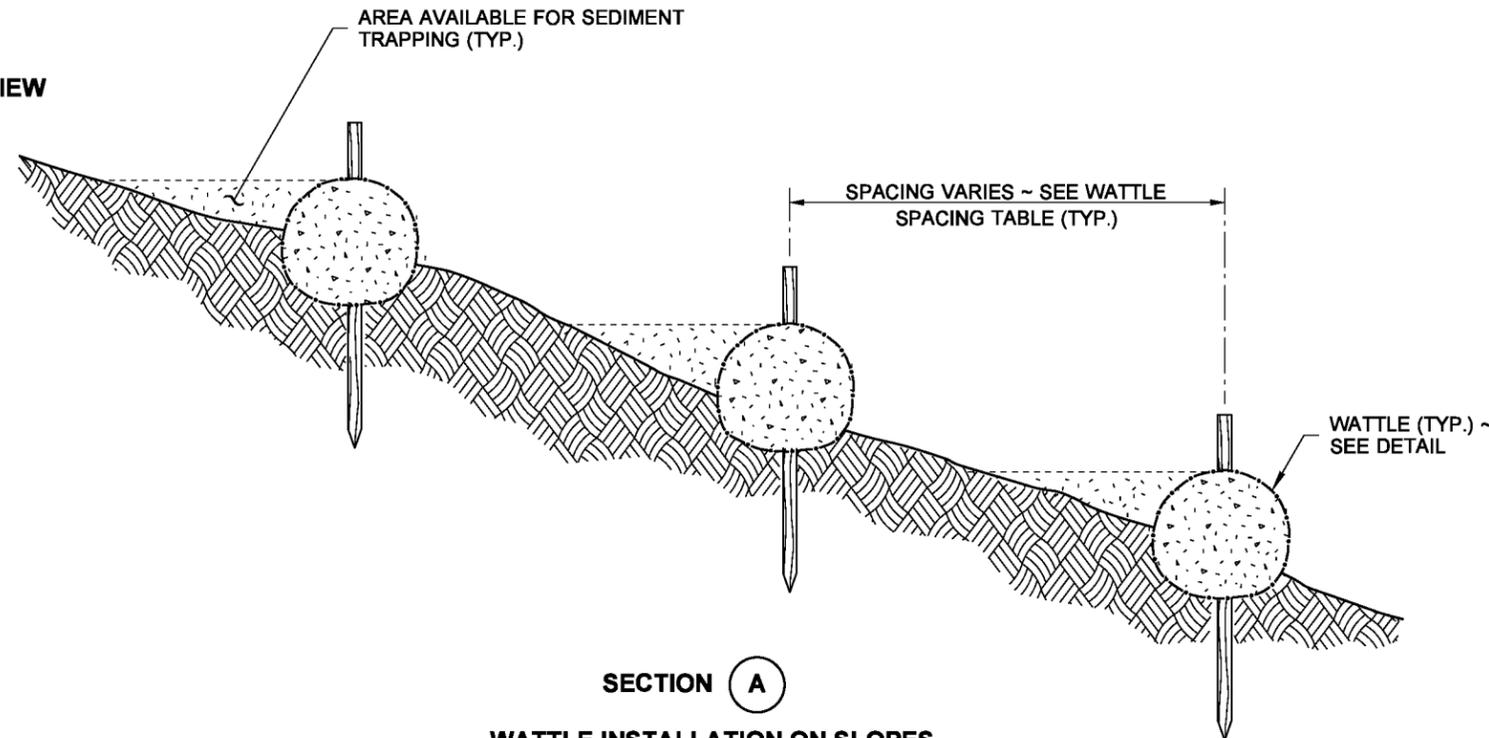

SECTION A  
WATTLE INSTALLATION ON SLOPES

8" DIAMETER WATTLE SPACING TABLE	
SLOPE	MAXIMUM SPACING
1H : 1V	10' - 0"
2H : 1V	20' - 0"
3H : 1V	30' - 0"
4H : 1V	40' - 0"

NOTES

1. Wattles shall be in accordance with **Standard Specification 9-14.5(5)**. Install Wattles along contours. Installation shall be in accordance with **Standard Specification 8-01.3(10)**.
2. Securely knot each end of Wattle. Overlap adjacent Wattle ends 12" behind one another and securely tie together.
3. Compact excavated soil and trenches to prevent undercutting. Additional staking may be necessary to prevent undercutting.
4. Install Wattle perpendicular to flow along contours.
5. Wattles shall be inspected regularly, and immediately after a rainfall produces runoff, to ensure they remain thoroughly entrenched and in contact with the soil.
6. Perform maintenance in accordance with **Standard Specification 8-01.3(15)**.
7. Refer to **Standard Specification 8-01.3(16)** for removal.



STATE OF WASHINGTON  
REGISTERED  
LANDSCAPE ARCHITECT

Sandra L. Salisbury  
SANDRA L. SALISBURY  
LICENSE NO. 860

DATE: June 10, 2013

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION, IS KEPT ON FILE AT THE WASHINGTON STATE DEPARTMENT OF TRANSPORTATION. A COPY MAY BE OBTAINED UPON REQUEST.

**WATTLE INSTALLATION ON SLOPE**

**STANDARD PLAN I-30.30-01**

SHEET 1 OF 1 SHEET

APPROVED FOR PUBLICATION

**Pasco Bakotich III** 6/10/13

STATE DESIGN ENGINEER DATE

