

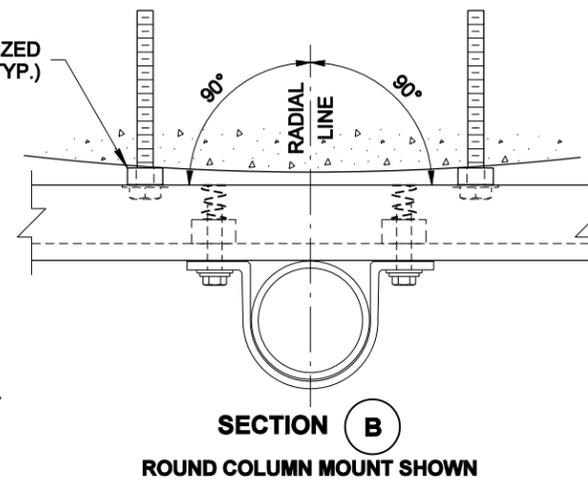
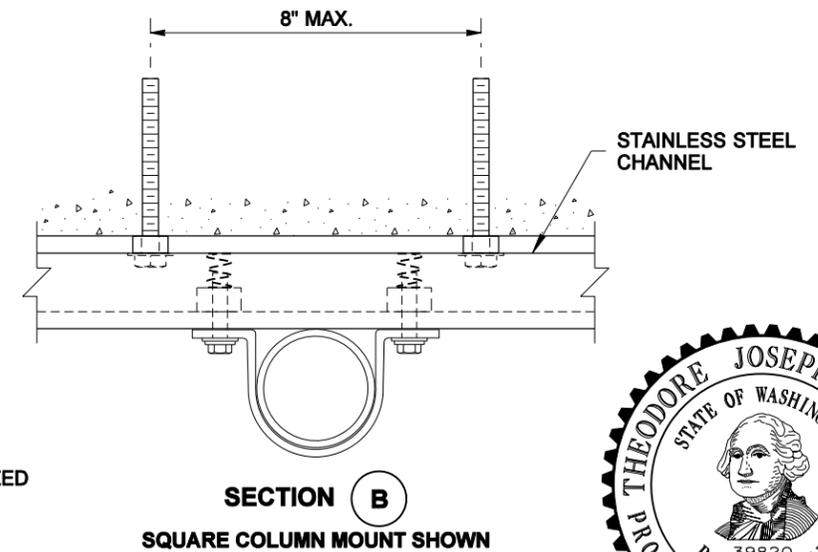
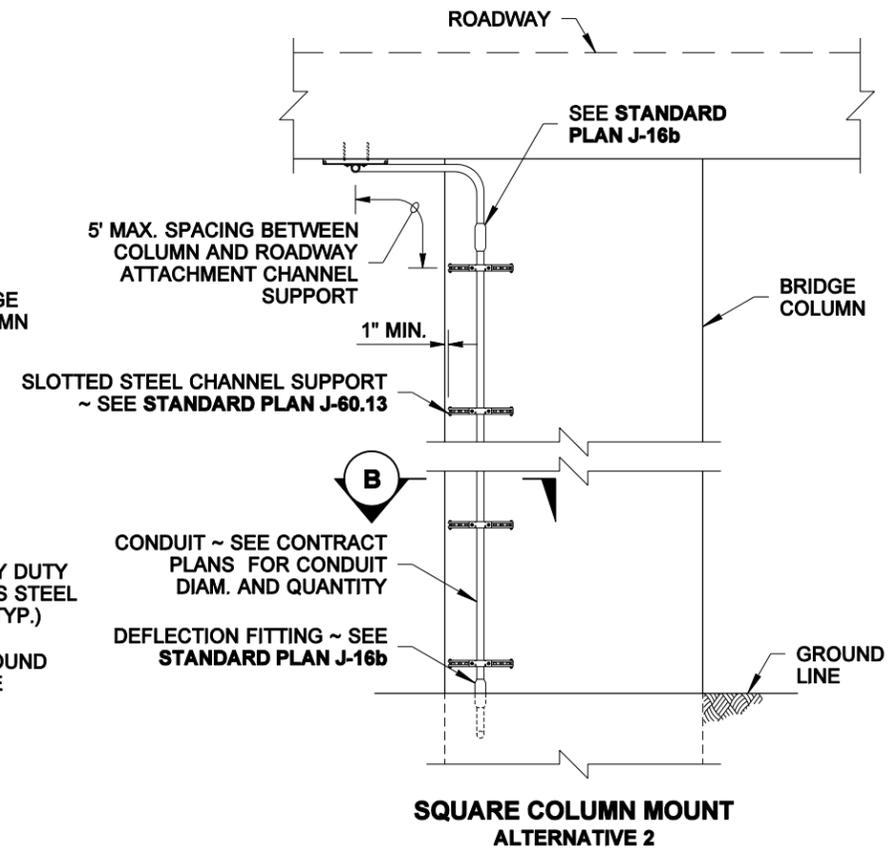
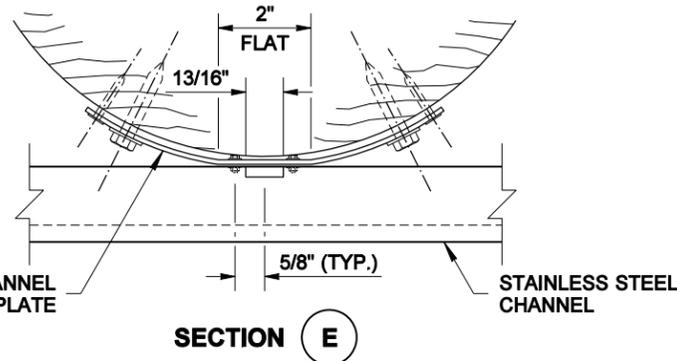
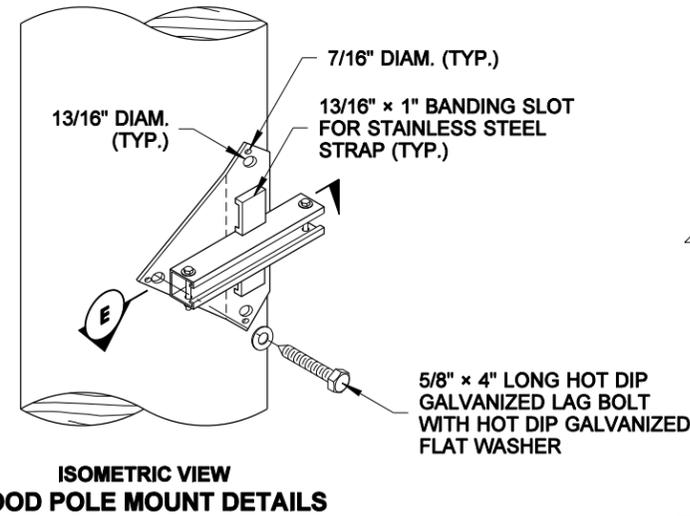
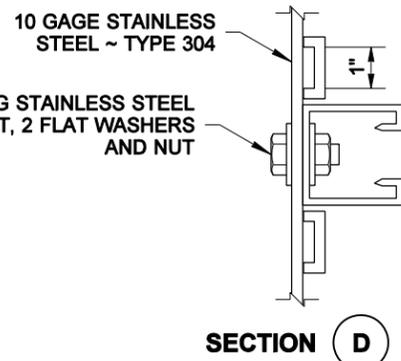
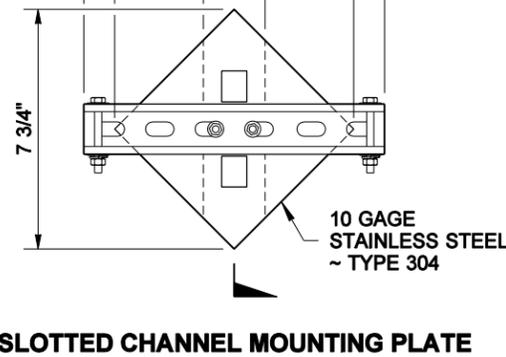
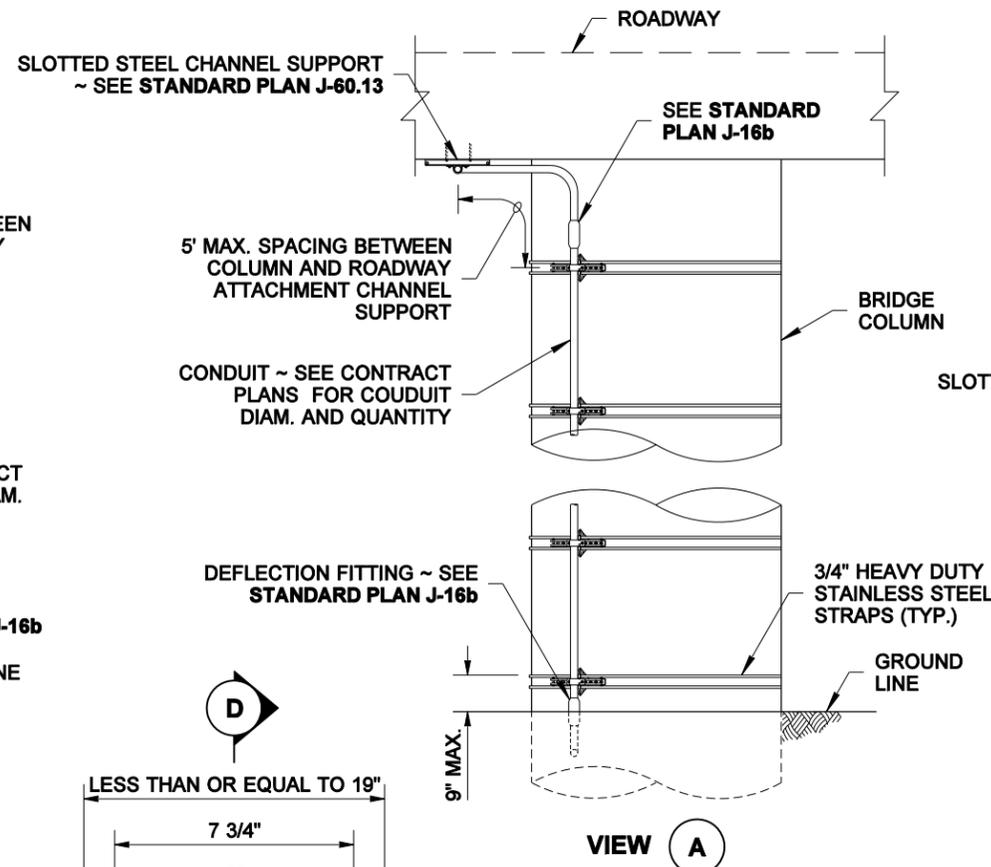
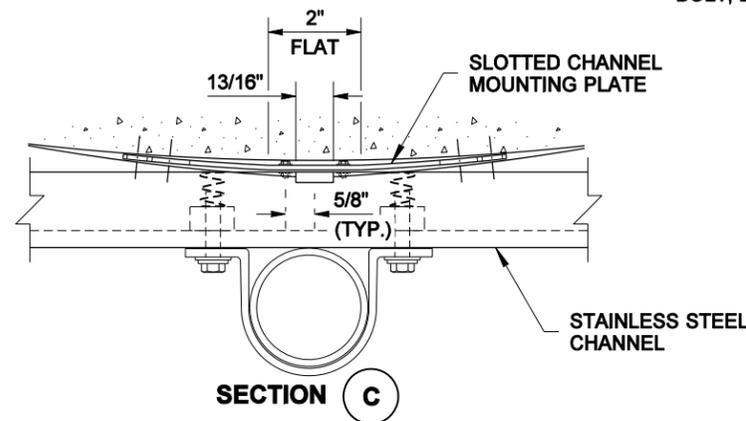
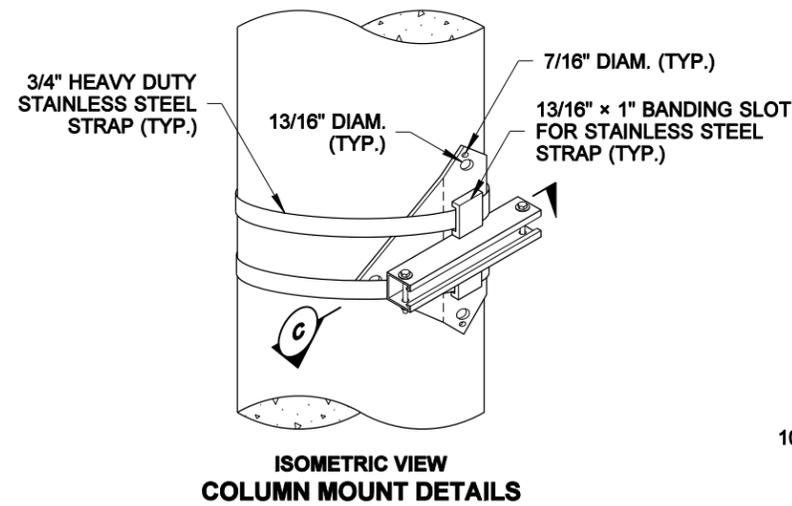


DRAWN BY: LISA CYFORD

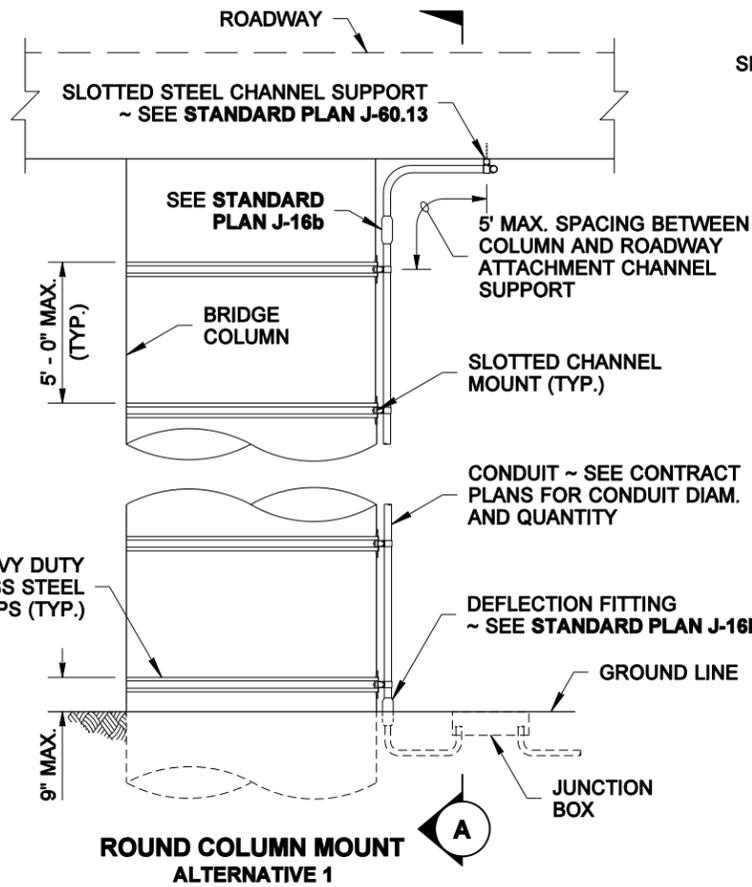

NOTES

1. See Standard Plan J-60.13 for Slotted Steel Channel details.
2. Stainless Steel Channel to be plumb to face of structure. Size spacer to maintain plumb line.
3. Slotted Channel mounting plate shall be installed where conduit is routed along column.
4. See Contract Plans for specified Alternative attachment type.

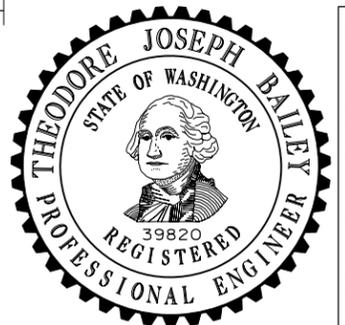

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT UNTIL IT IS APPROVED BY THE ENGINEER AND APPROVED BY THE BOARD OF TRANSPORTATION. A COPY MAY BE OBTAINED UPON REQUEST.

STAINLESS STEEL CHANNEL MOUNTING DETAILS ON COLUMN OR POLE STANDARD PLAN J-60.14-00

SHEET 1 OF 1 SHEET

APPROVED FOR PUBLICATION

Pasco Bakotich III 06-16-10

STATE DESIGN ENGINEER

DATE



Washington State Department of Transportation