

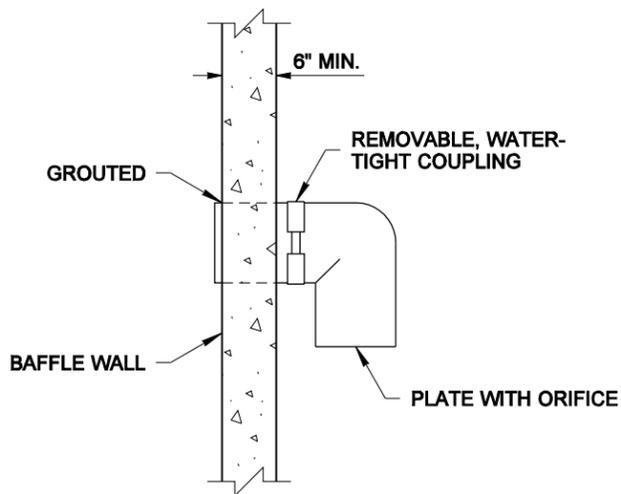
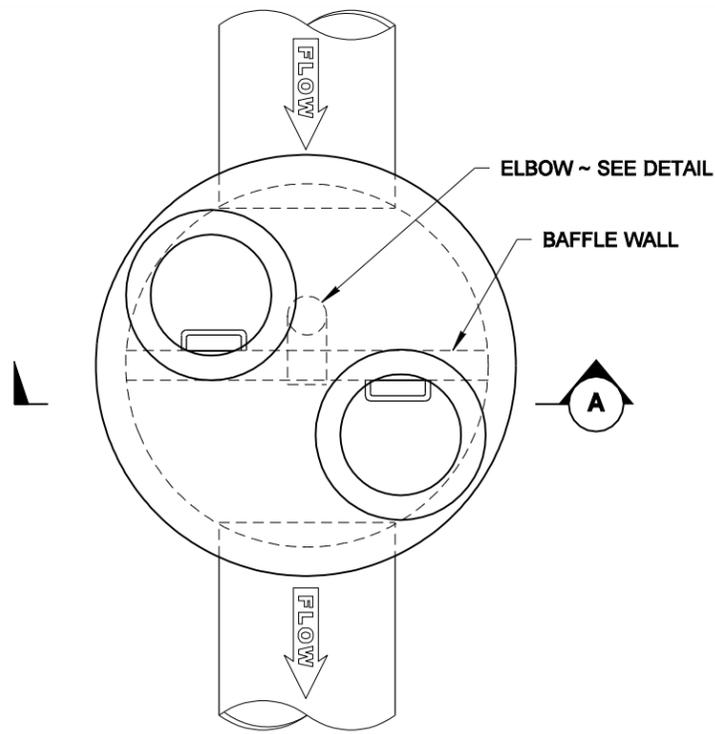


DRAWN BY: ADAM COCHRAN

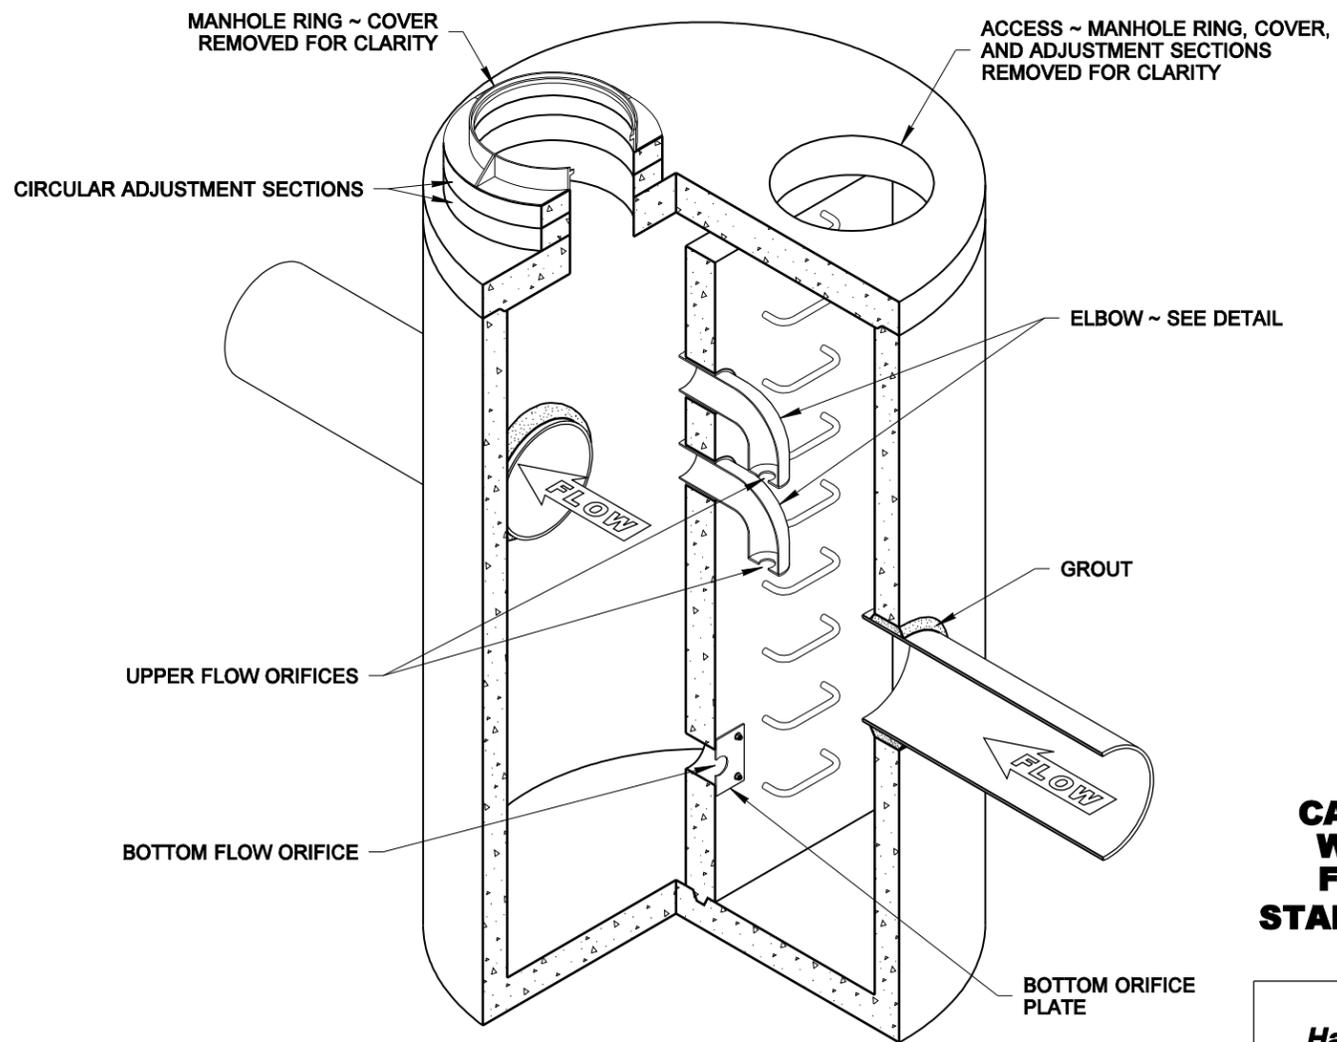

**NOTES**

1. See Contract for size and location of all pipes and orifices.
2. Baffle wall shall have #4 Bar at 12" spacing each way.
3. Precast baffle shall be keyed and grouted in place.
4. Bottom orifice plate shall be galvanized steel with a minimum thickness of 1/4". Attach orifice with 1/2" stainless steel bolts.
5. Upper flow orifice plates and elbows shall be aluminum, aluminized steel or galvanized steel. Galvanized steel shall have Treatment 1.

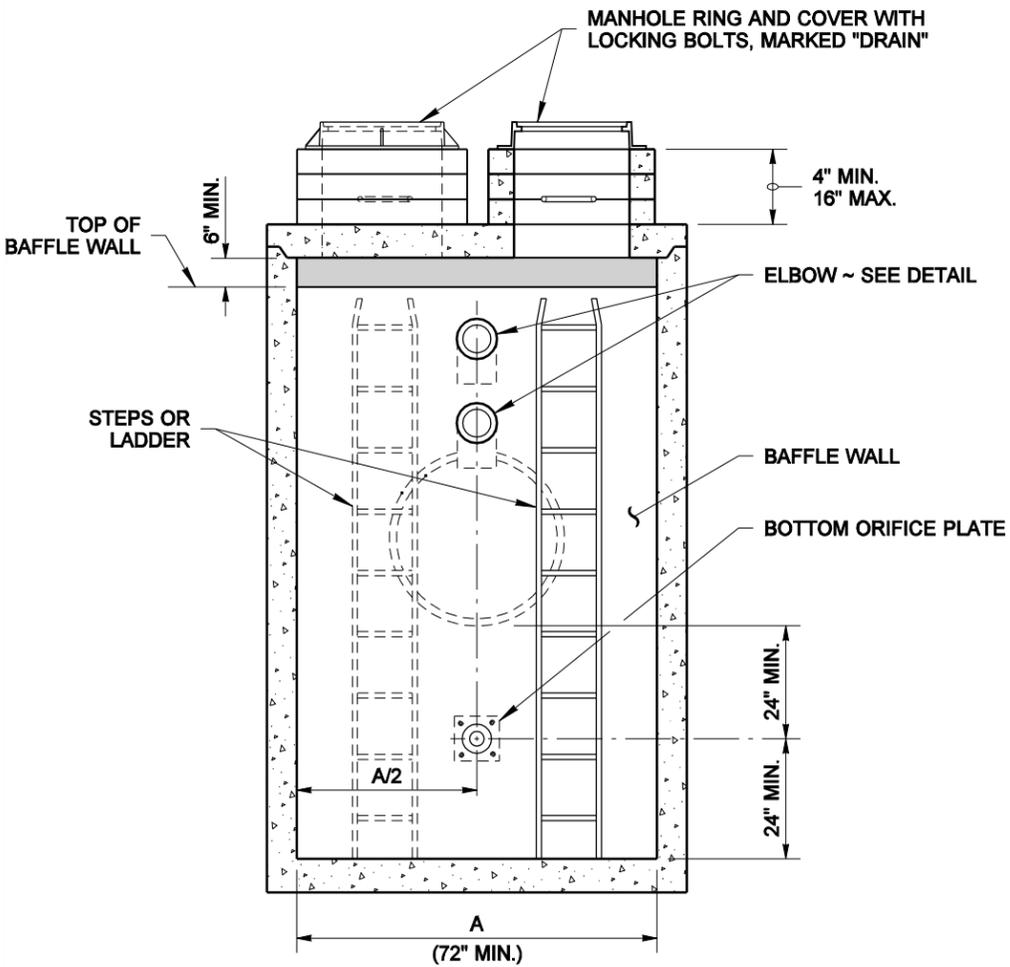

EXPIRES JULY 1, 2007

**CATCH BASIN TYPE 2  
WITH BAFFLE TYPE  
FLOW RESTRICTOR  
STANDARD PLAN B-10.60-00**

SHEET 1 OF 1 SHEET

APPROVED FOR PUBLICATION

**Harold J. Peterfeso** 06-08-06  
STATE DESIGN ENGINEER DATE

Washington State Department of Transportation

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT  
NOT BE USED FOR CONSTRUCTION OR FOR ANY OTHER PURPOSE  
UNLESS THE ENGINEER HAS APPROVED FOR PUBLICATION. THIS PLAN IS  
FILED AT THE WASHINGTON STATE DEPARTMENT OF TRANSPORTATION.  
A COPY MAY BE OBTAINED UPON REQUEST.