NOTES

1. Air release/air vacuum valve shall be size specified in Contract. Piping and valves to be same size as air release valve/air vacuum valve.
2. Locate at high point of main.
3. Tap top of main.
4. Provide insulation when specified.

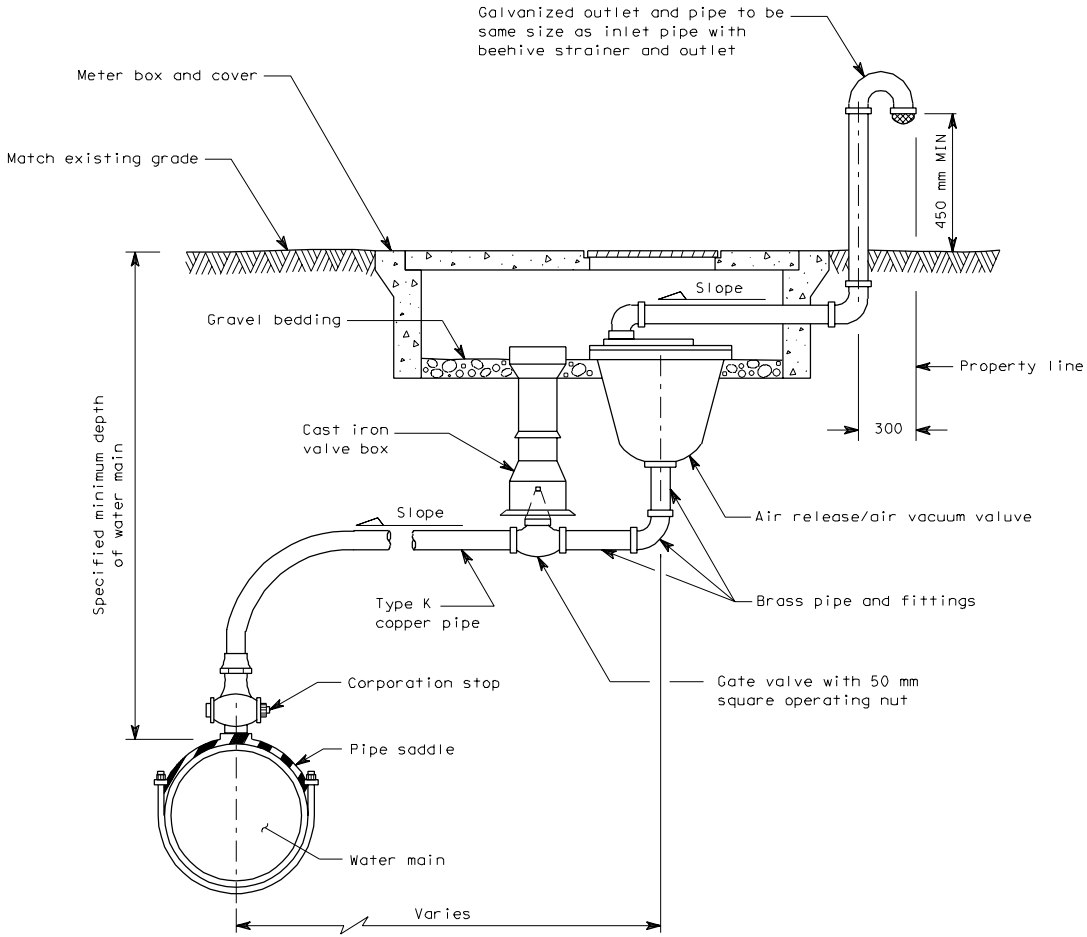

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED

COMBINATION AIR RELEASE/ AIR VACUUM VALVE ASSEMBLY

STANDARD PLAN B-21a

APPROVED FOR PUBLICATION

STATE DESIGN ENGINEER DATE

WASHINGTON STATE DEPARTMENT OF TRANSPORTATION
OLYMPIA, WASHINGTON